



NOTE:
ALL UTILITIES ARE SHOWN IN THEIR
APPROXIMATE LOCATION AND
MUST BE FIELD VERIFIED.
THERE MAY BE EXISTING UTILITIES NOT SHOWN.
811 SUNSHINE SHALL BE NOTIFIED
48 HRS PRIOR TO CONSTRUCTION.

CGS PERMIT DOT#18-09G
FENCEPOST DRIVE
ODESSA

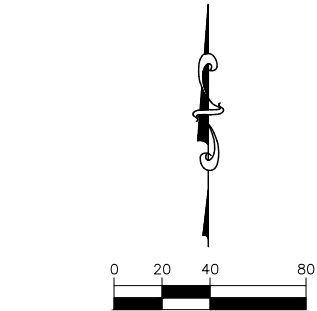

Clearwater Gas System
Natural & Propane Gas
400 NORTH MYRTLE AVENUE
CLEARWATER, FL 34615

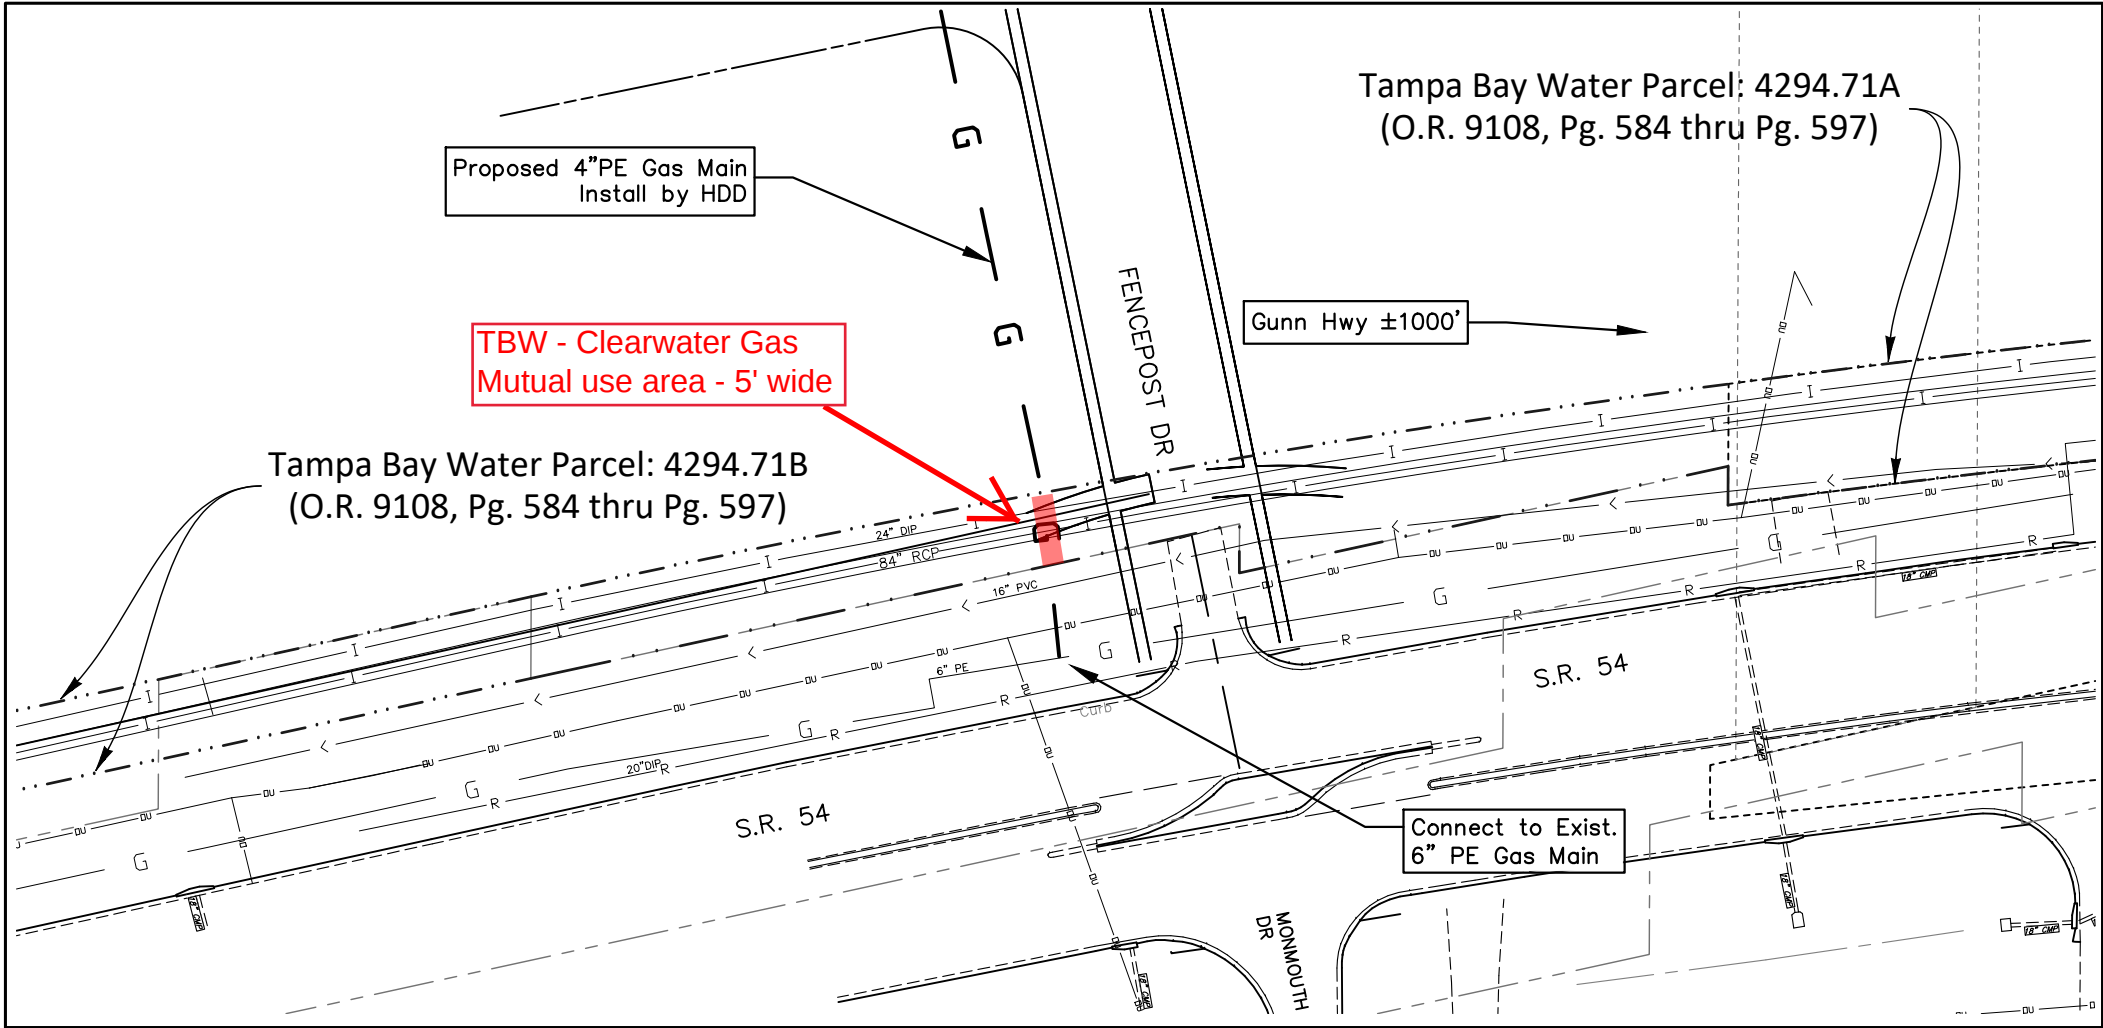

- G— GAS LINE
 - DU— OH UTILITY
 - R— RECLAIM WM
 - >— SANITARY
 - I— WATER MAIN
-
- RIGHT OF WAY
 - UTILITY EASEMENT
 - (50) RIGHT OF WAY
- PROPOSED=BOLD\SOLID
-
- Ⓒ GAS
 - Ⓓ RECLAIM
 - Ⓢ SANITARY
 - Ⓦ WATER MAIN

INSTALL WITH A MIN. DEPTH OF 36"
MAINTAIN A MIN. CLEARANCE OF 24" FROM ALL EXIST. UTILITIES, 36" FROM TAMPA BAY WM.
LOCATION & DEPTH MAY VARY BASED ON EXIST. FIELD CONDITIONS.
LOCATION & DEPTH OF GAS SHALL BE VERIFIED AND DOCUMENTED

DRAWN:	J BUFFIE
DATE:	5/25/18
	DOT#18-09G
SHEET	1 OF 1