

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

P1 - 137
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED

P2 - 249
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED

P3 - 251
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED

P4 - 68
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED

S1 - 220'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9

S2 - 213'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9

S3 - 350'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9

S4 - 275'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9

911 ADDRESS:
320 CLEVELAND ST
CLEARWATER FL, 33755


SCOPE OF WORK:
THIS WORK ORDER CALLS FOR THE REMOVAL OF 1791' OF
3Ø 4/0CU CABLE FROM CIRCUIT C8 AND 1866' FROM CIRCUIT C9
REMOVE CONNECTORS INSIDE MANHOLES
REMOVE CABLE FROM MH 125 TO EXISTING PME'S

DUKE ENERGY
PROJECT MANAGER
STEPHEN ANDERSON
PHONE: 320-420-2463

DUKE ENERGY
ENGINEER
MARK MICHAEL
PHONE: 727-418-5307

CONTRACT PARTNER
THOMAS WHEELER
PHONE: 407-243-3713

Work Order Number	35762842
Customer/Contact	
Contact Phone	
Job Site Address	320 CLEVELAND ST
City	CLEARWATER
County	PINELLAS
State, Zip	FL, 33755
Designer	DANIEL MCLEOD
Designer Phone	407-374-5399
Circuit ID	C8/C9
Primary Voltage	12.47/7.2KV
Permit Required	Yes___ NoX
Permit Type/No.	
Permit Type/No. 2	
Permit Type/No. 3	
Permit Type/No. 4	

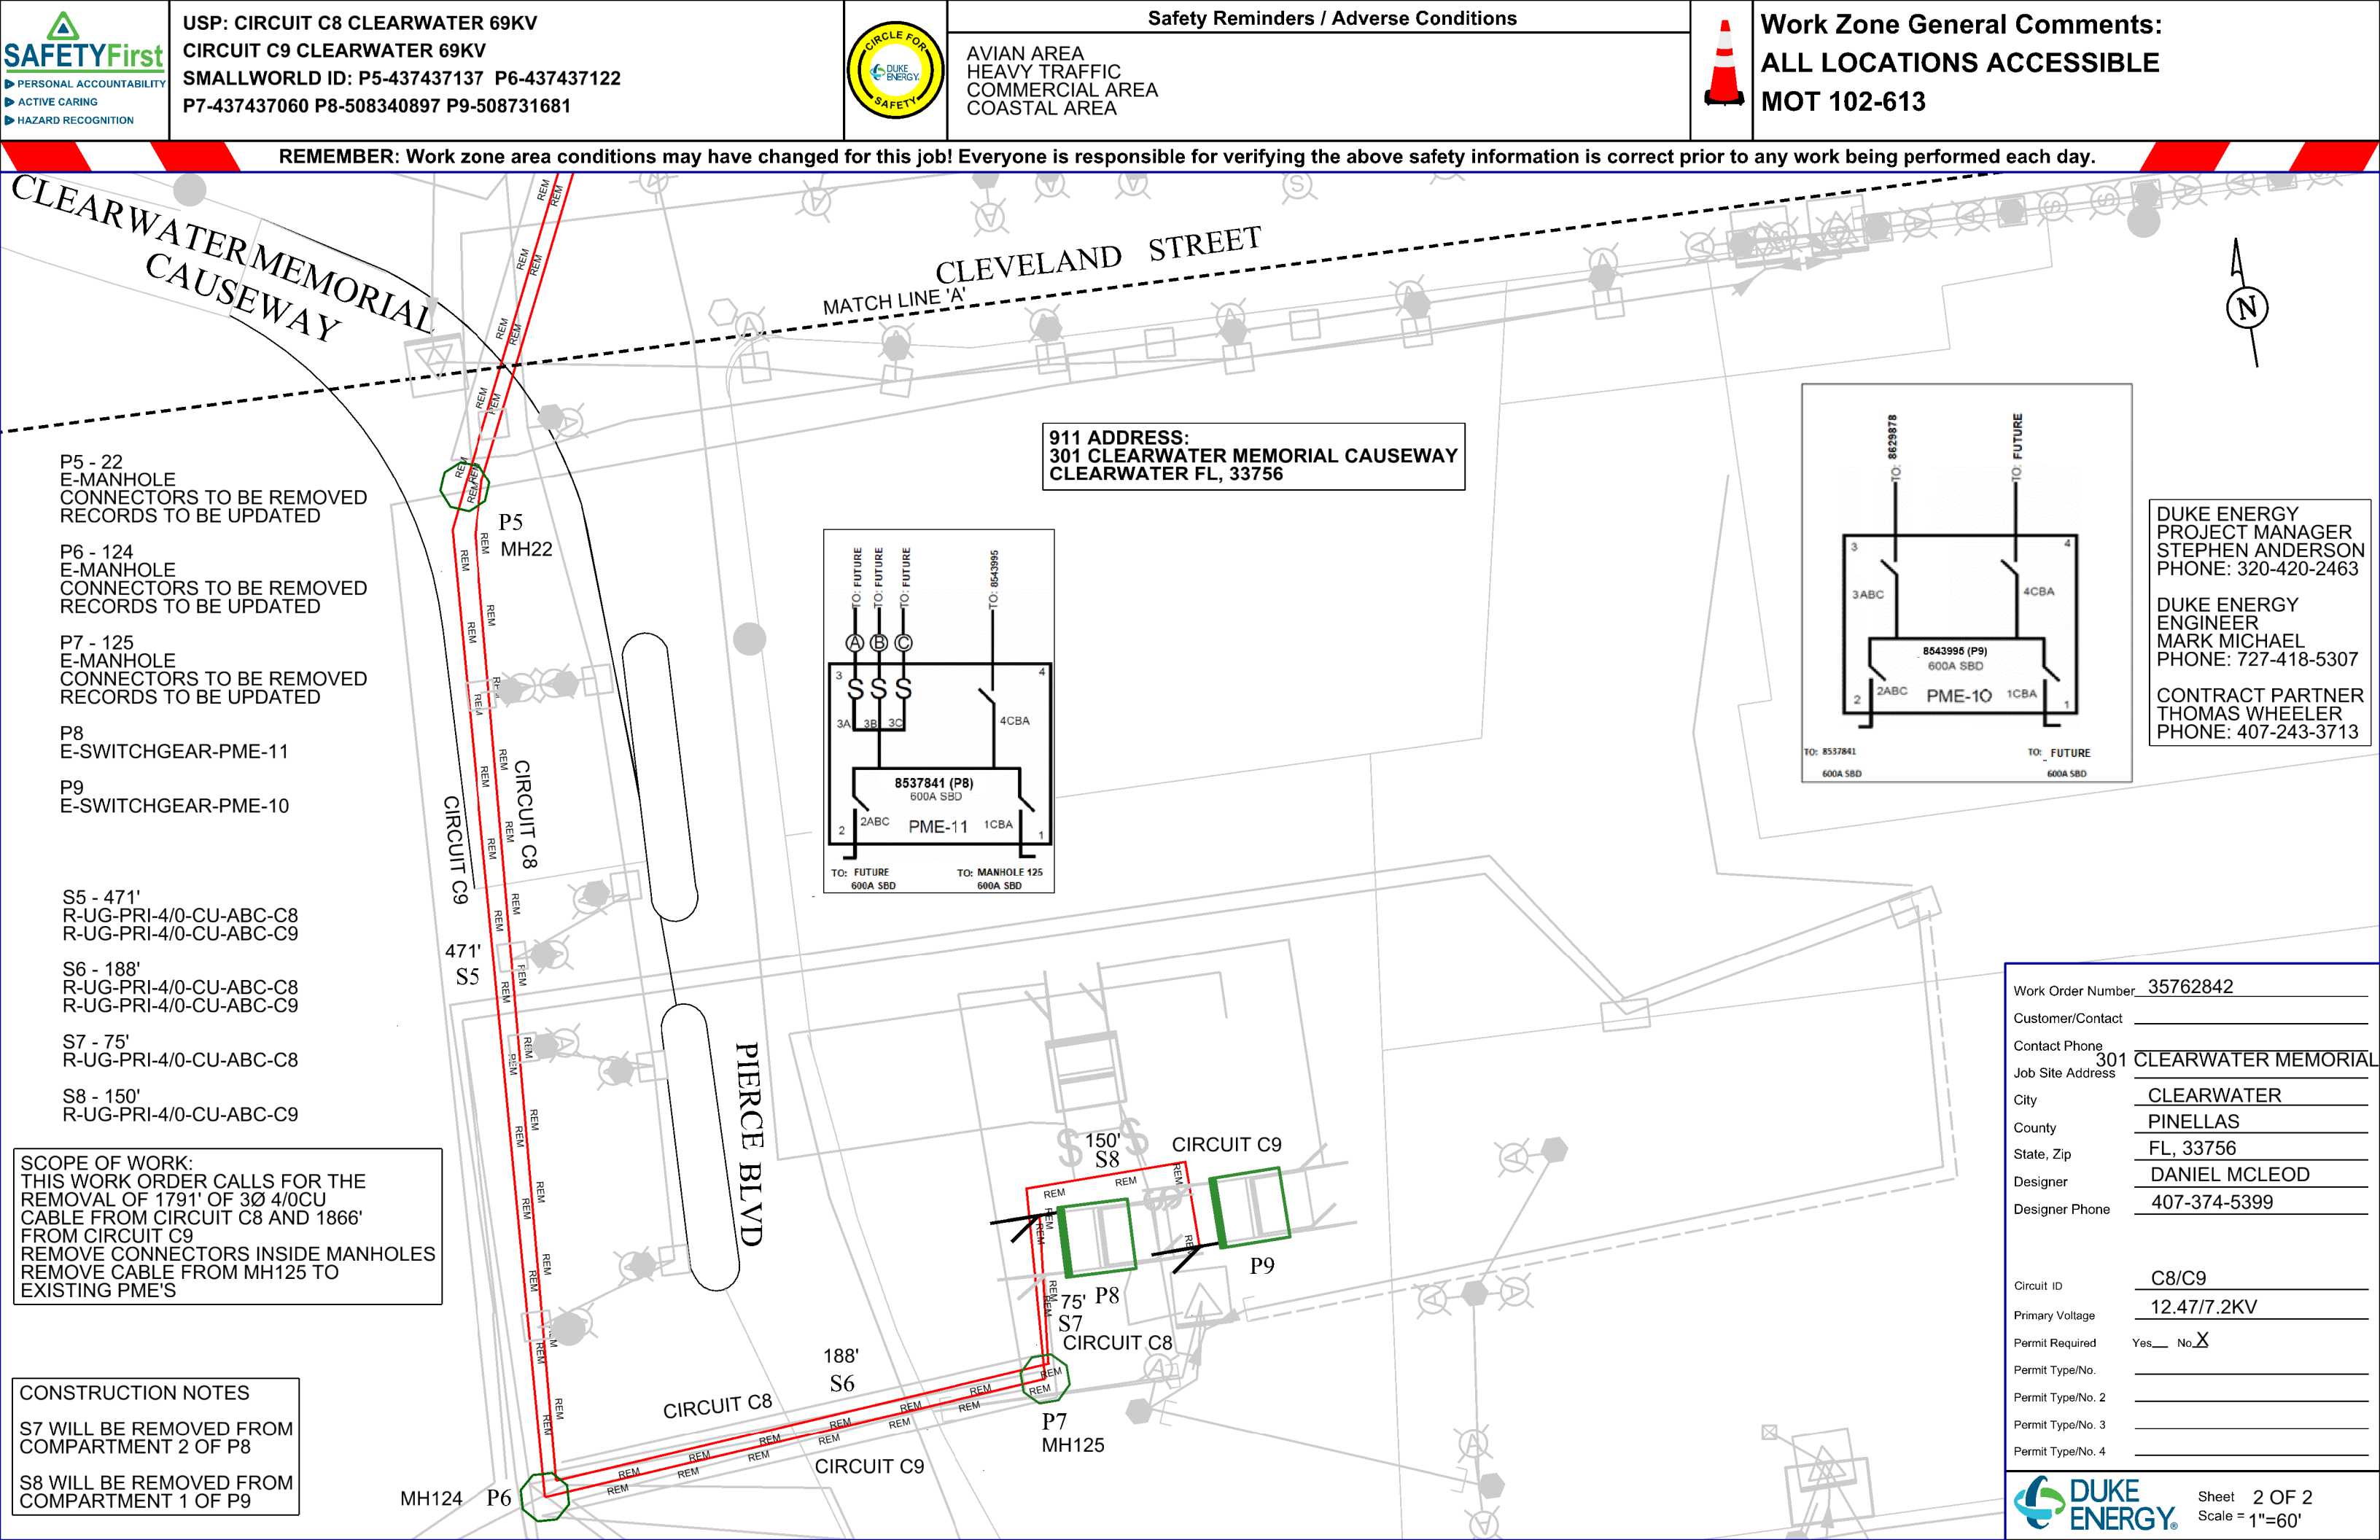

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.



- P5 - 22
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED
- P6 - 124
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED
- P7 - 125
E-MANHOLE
CONNECTORS TO BE REMOVED
RECORDS TO BE UPDATED
- P8
E-SWITCHGEAR-PME-11
- P9
E-SWITCHGEAR-PME-10

- S5 - 471'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9
- S6 - 188'
R-UG-PRI-4/0-CU-ABC-C8
R-UG-PRI-4/0-CU-ABC-C9
- S7 - 75'
R-UG-PRI-4/0-CU-ABC-C8
- S8 - 150'
R-UG-PRI-4/0-CU-ABC-C9

SCOPE OF WORK:
THIS WORK ORDER CALLS FOR THE
REMOVAL OF 1791' OF 3Ø 4/0CU
CABLE FROM CIRCUIT C8 AND 1866'
FROM CIRCUIT C9
REMOVE CONNECTORS INSIDE MANHOLES
REMOVE CABLE FROM MH125 TO
EXISTING PME'S

CONSTRUCTION NOTES
S7 WILL BE REMOVED FROM
COMPARTMENT 2 OF P8
S8 WILL BE REMOVED FROM
COMPARTMENT 1 OF P9

911 ADDRESS:
301 CLEARWATER MEMORIAL CAUSEWAY
CLEARWATER FL, 33756

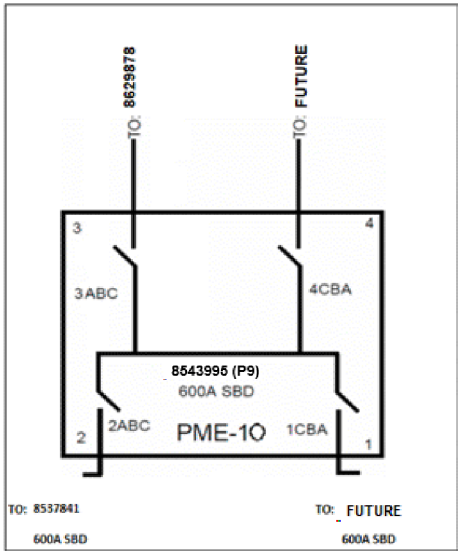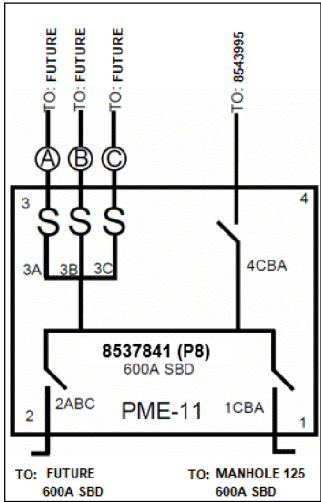

DUKE ENERGY
PROJECT MANAGER
STEPHEN ANDERSON
PHONE: 320-420-2463

DUKE ENERGY
ENGINEER
MARK MICHAEL
PHONE: 727-418-5307

CONTRACT PARTNER
THOMAS WHEELER
PHONE: 407-243-3713

Work Order Number 35762842
Customer/Contact
Contact Phone 301 CLEARWATER MEMORIAL
Job Site Address
City CLEARWATER
County PINELLAS
State, Zip FL, 33756
Designer DANIEL MCLEOD
Designer Phone 407-374-5399

Circuit ID C8/C9
Primary Voltage 12.47/7.2KV
Permit Required Yes___ No_X
Permit Type/No.
Permit Type/No. 2
Permit Type/No. 3
Permit Type/No. 4